


A.s. Tørrkopi. 945. 300. Sentrum Trykkeri.

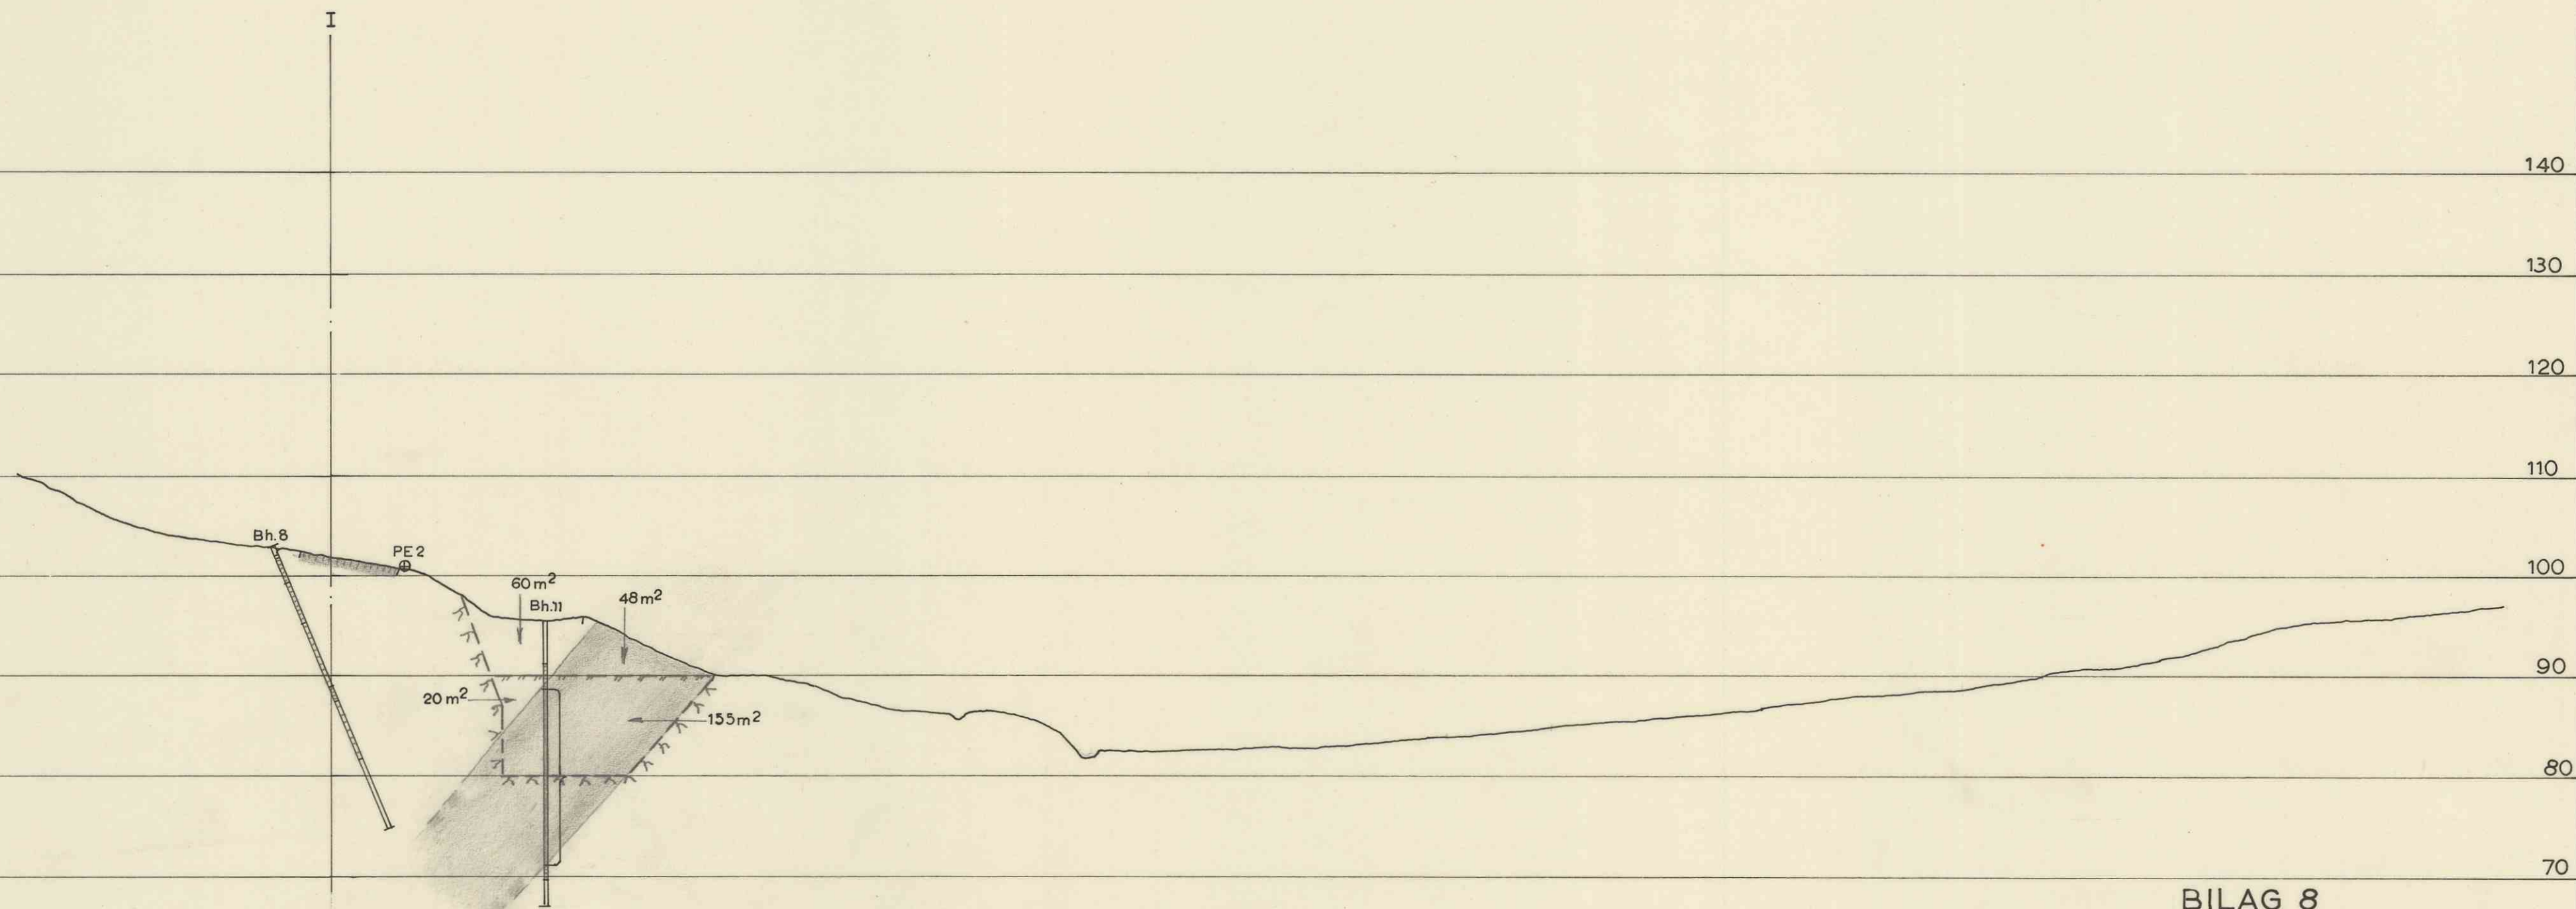

Bh.9

Analyseprøve	Al ₂ O ₃
4.00 - 6.00 m	2.20 %
6.00 - 8.40 "	2.70 "

Bh.11

Analyseprøve	Al ₂ O ₃
5.85 - 6.85 m	8.00 %
6.85 - 9.00 "	0.35 "
9.00 - 11.00 "	0.55 "
11.00 - 14.00 "	1.00 "
14.00 - 17.00 "	0.66 "
17.00 - 20.00 "	0.49 "
20.00 - 23.00 "	0.92 "
23.00 - 24.30 "	0.44 "

SiO₂ = 98,6 %

Al₂O₃ = 0,63 "

TiO₂ = 0,04 "

Fe₂O₃ = 0,13 "

P = 0,002 "

BILAG 8
10.mars 1966

Profil E5
KVARSITTSONE E
Fauskeidet.

M. 1:500

Skorovas 24.1.66/

10500

P4-21-109