


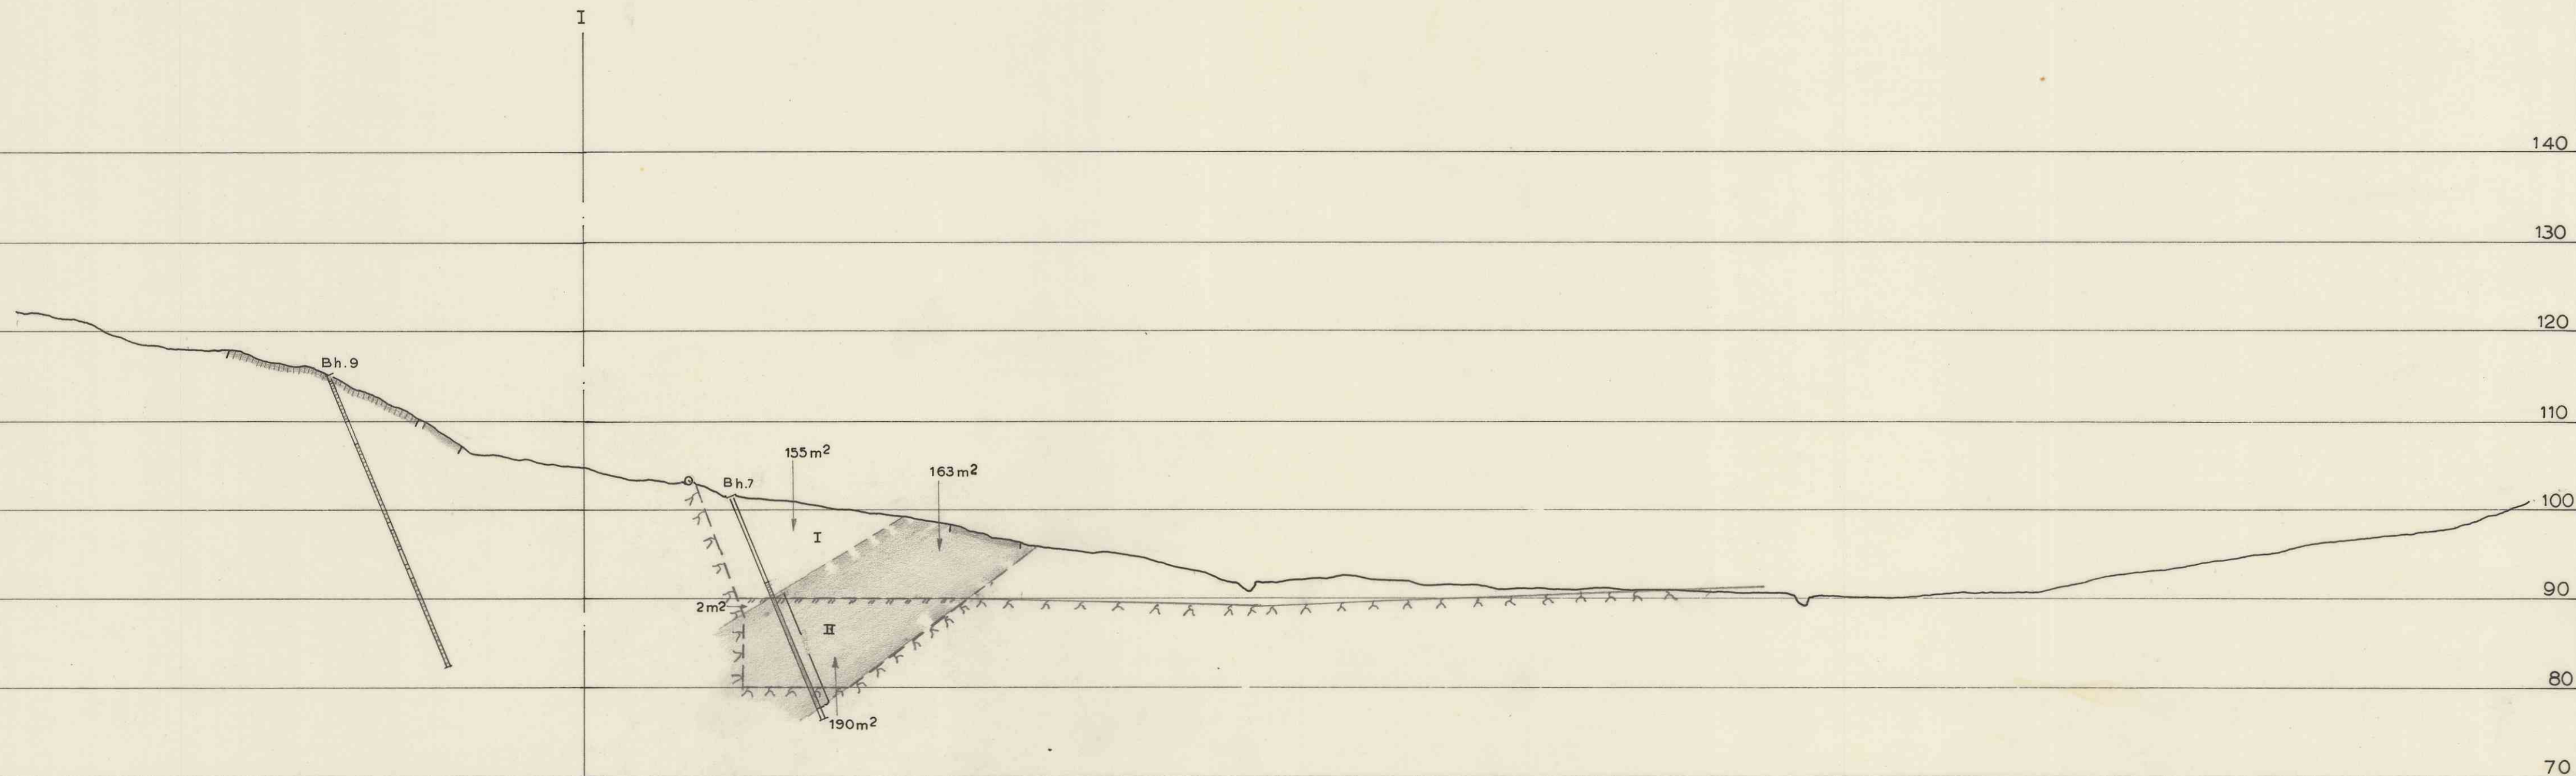

Bh.7			
Analysepröve	Al ₂ O ₃		
12.20 - 14.00 m	0.47%	SiO ₂ =	98,9 %
14.00 - 17.00 "	0.62 "	Al ₂ O ₃ =	0,51 "
17.00 - 20.00 "	0.58 "	TiO ₂ =	0,04 "
20.00 - 23.00 "	0.40 "	Fe ₂ O ₃ =	0,09 "
23.00 - 25.70 "	0.30 "	P =	0,002 "

BILAG 7
10.mars 1966

Profil E4

KVARTSITTSONE E
Fauskeidet

M. 1:500

10501

Skorovas 24.1. 66/

P4-21-109