


ISOANOMALIKART MEISINSET III

M-1:1000



Fargeskala

- 10000-50000 γ
- 5000-10000 γ
- 2500-5000 γ
- 1000-2500 γ
- 0-1000 γ
- Neg. Verdier

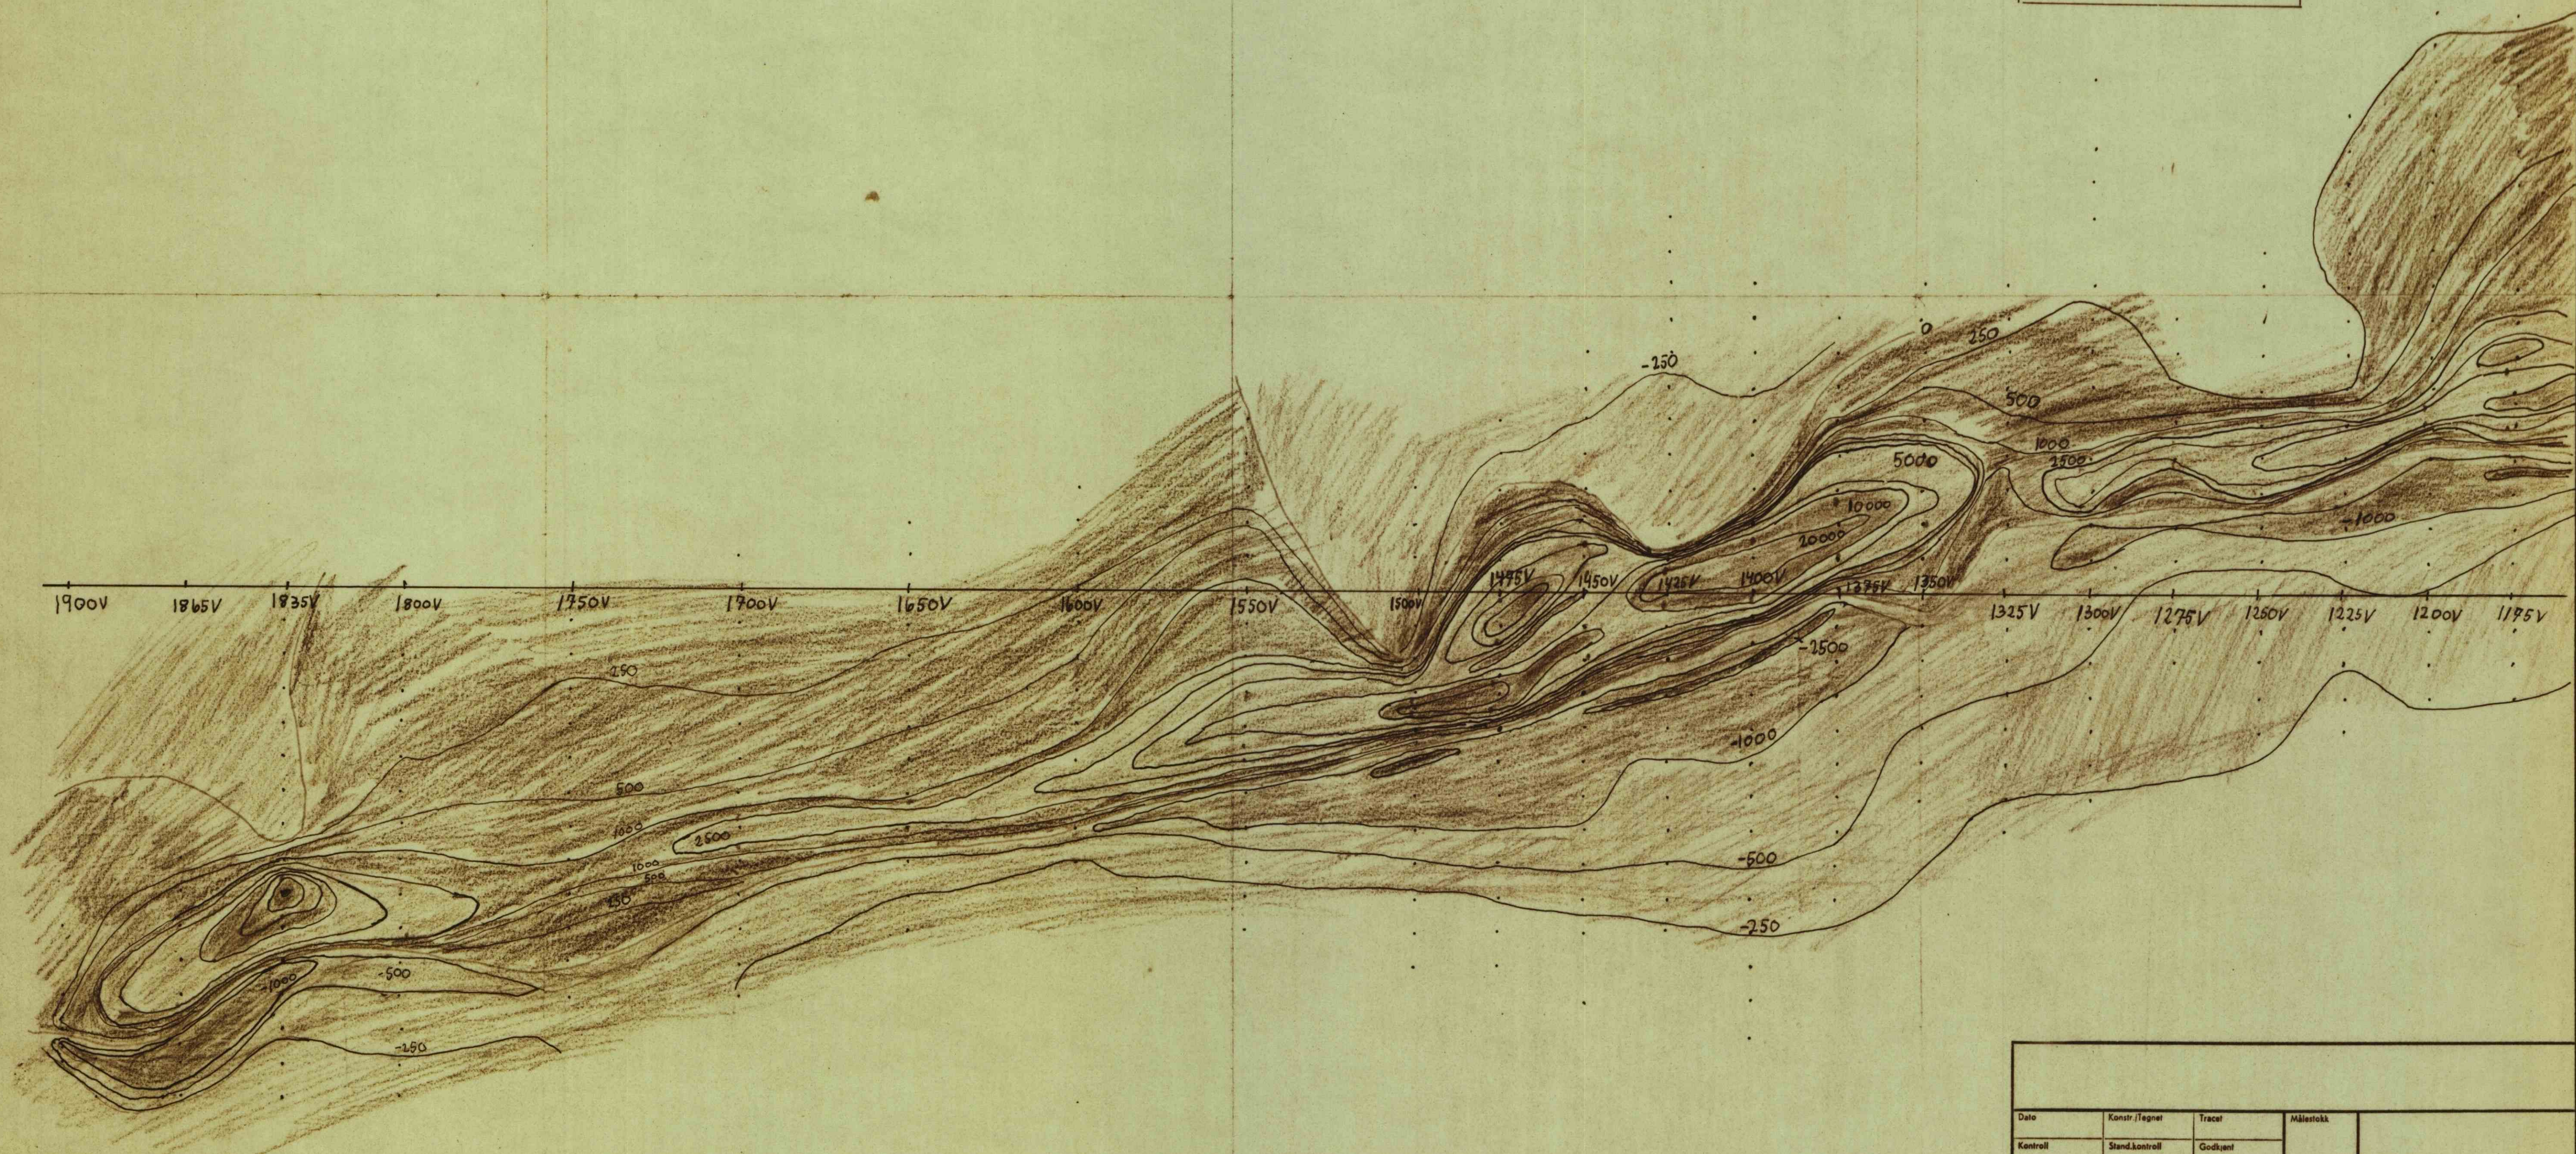

Dato	Konstr./Tegnet	Tracer	Målestokk	Erstatning for:	Erstattet av:
Kontroll	Stand.kontroll	Godkjent			
10				2419	C.W.C.
Henvisning:		Beregning:			