


Analyseresultaten					
Prov m.	SiO ₂	Al ₂ O ₃	P	Longit.	Måttighet.
1	88.80	4.91	0.0040	1.8	1.2
2	90.62	4.73	0.0046	1.5	0.9
3	96.85	1.70	0.0051	1.8	1.3
4	95.18	2.60	0.0055	2.2	1.4
5	94.48	2.24	0.0051	1.6	0.8
7	96.39	1.78	0.0047	1.6	0.7
8	98.22	1.29	0.0028	1.9	0.9
9	97.20	1.43	0.0051	1.9	1.1
10	96.53	2.00	0.0020	2.9	1.3
11	95.43	2.38	0.0032	1.7	1.55
12	96.11	2.04	0.0028	0	4.3
13	96.12	1.89	0.0030	3.1	2.0
14	94.18	2.95	0.0026	3.5	2.1
15				0.5	0.3
IA					
* B	89.33	5.25	0.0032		
* C	91.62	4.69	0.0045		
* D	95.88	1.96	0.0021		
* E	96.88	1.70	0.0028		
* F	97.57	1.17	0.0027		
* G	94.91	2.91	0.0028		
IIA					
* B	91.84	4.16	0.0060		
* C	85.20	9.06	0.0050		
* D	94.27	3.40	0.0060		
* E	97.17	1.36	0.0030		
* F	96.81	1.55	0.0028		
IIIA					
* B	96.85	1.89	0.0025		
* C	97.03	1.47	0.0045		
* D	91.43	4.25	0.0050		
* E	97.31	1.21	0.0028		

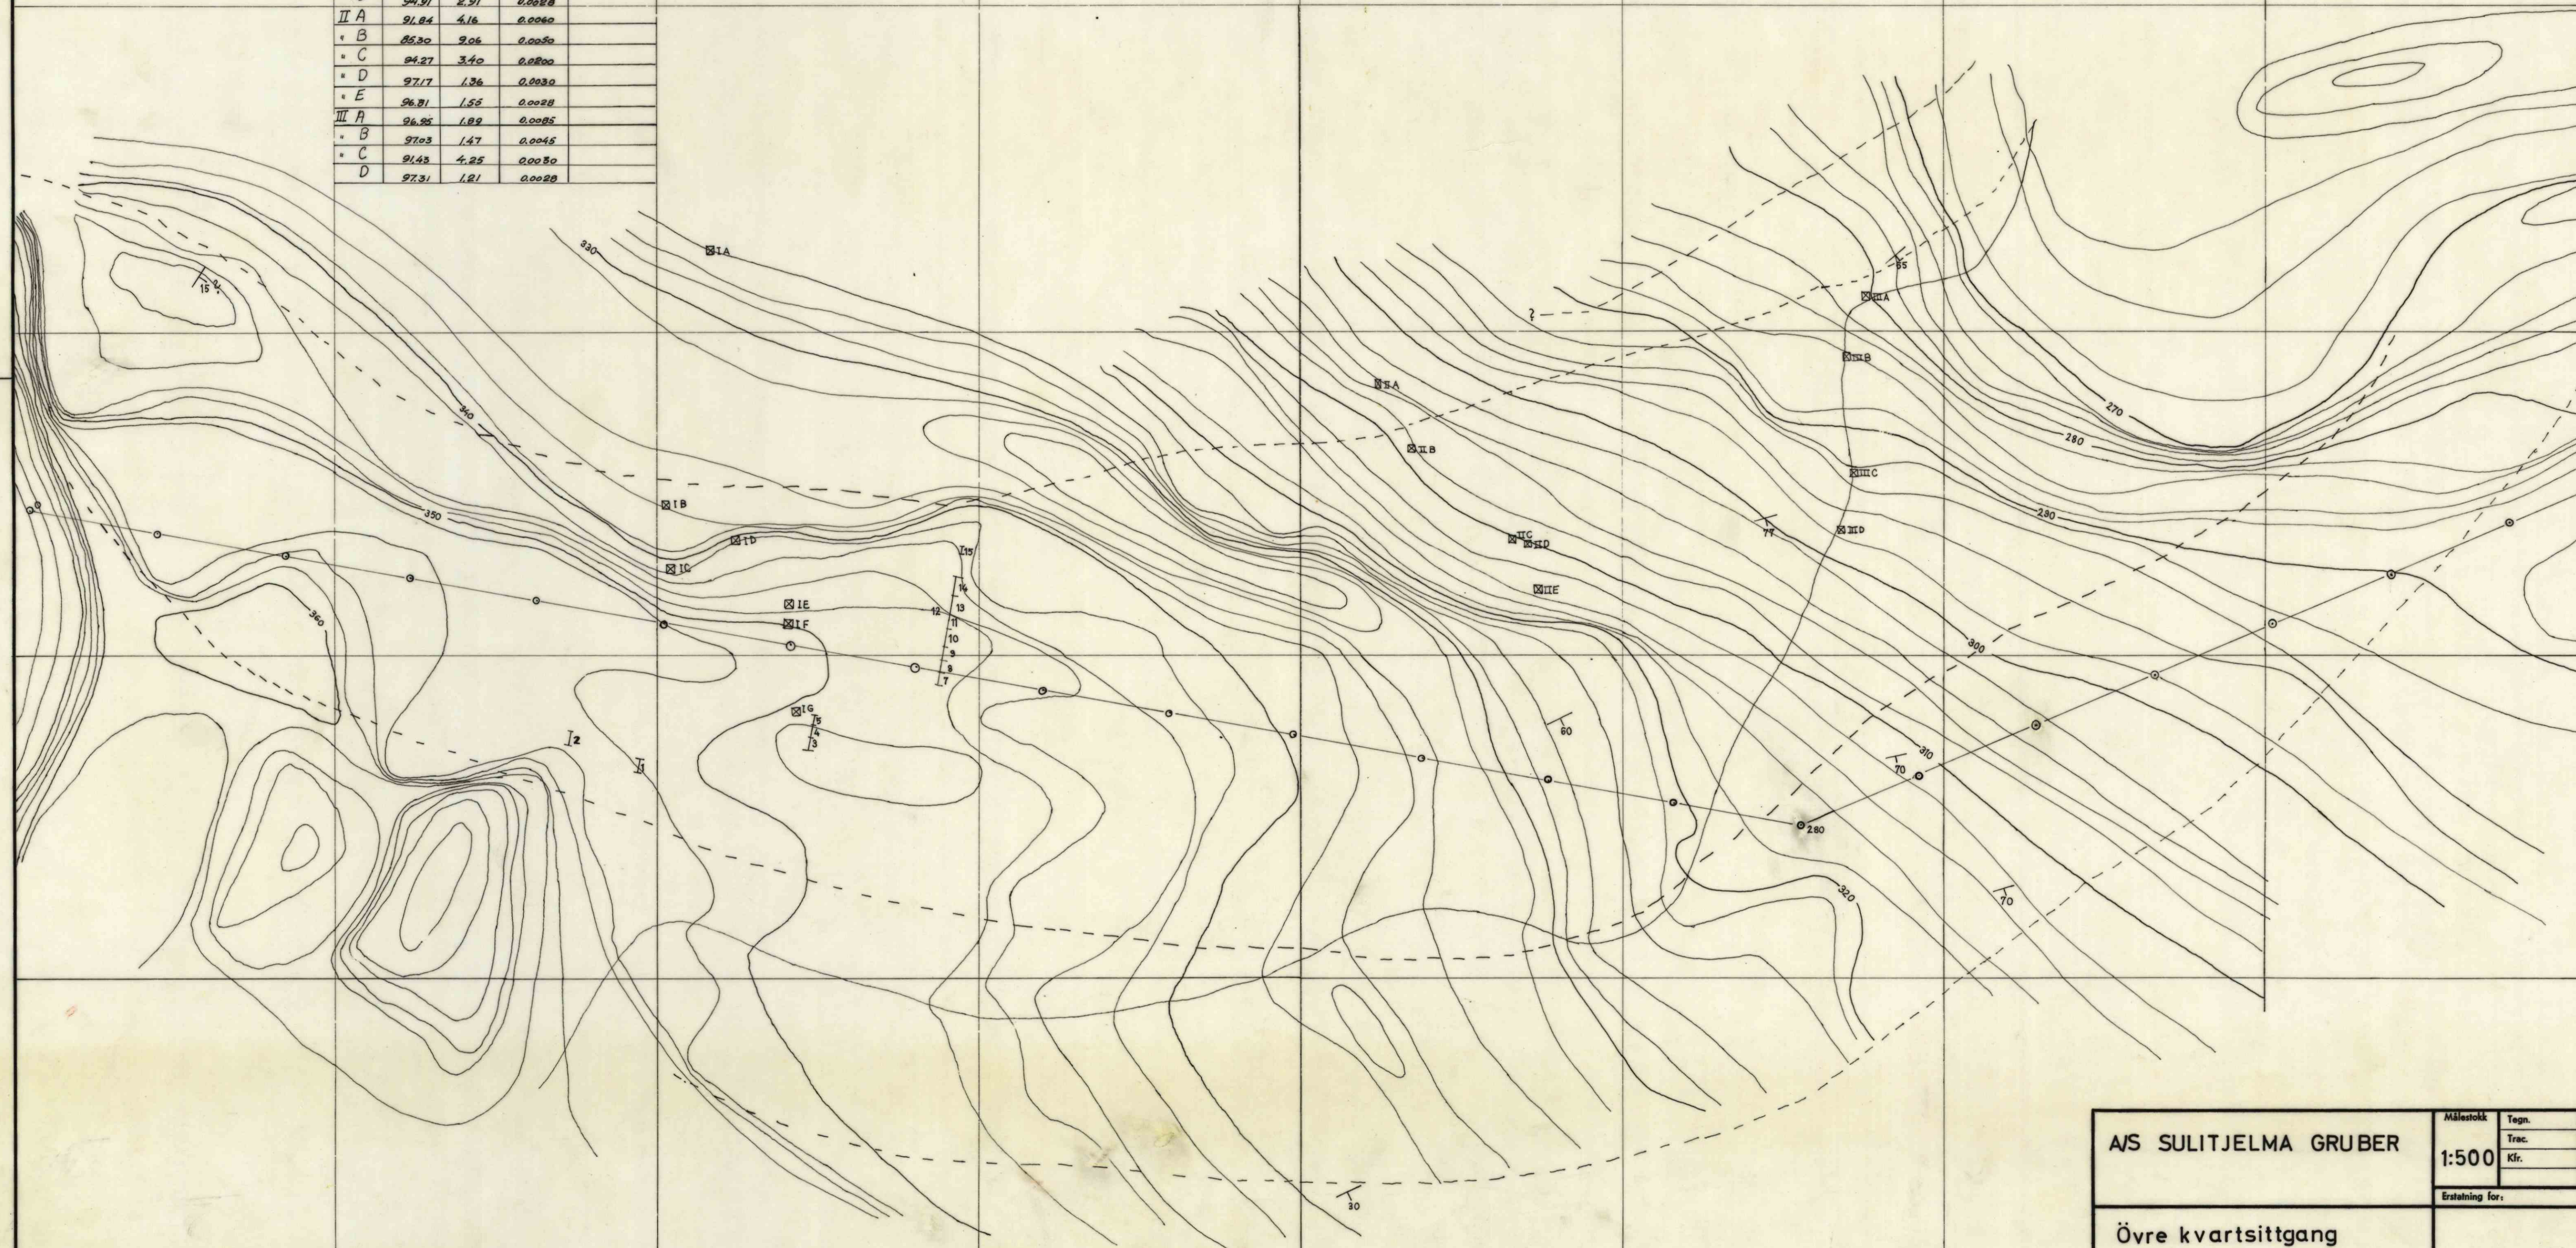

A/S SULITJELMA GRUBER

Målestokk	Tegn.
1:500	Trac.
	Kfr.
Ertatt av:	
Ertatt av:	

Övre kvartsittgang
KVANDAL